

# INSTALLATION INSTRUCTIONS

**STARTEK**  
ARCHITECTURAL LIGHTING



|                                                                                                                                                                                      |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED. |
| CE PRODUIT DOIT ETRE INSTALLE SELON LE CODE D'INSTALLATION PERTINENT, PAR UNE PERSONNE QUI CONNAIT BIEN LE PRODUIT ET SON FONCTIONNEMENT AINSI QUE LES RISQUES INHERENTS.            |
| DISCONNECT POWER PRIOR TO ANY INSTALLATION.                                                                                                                                          |
| DEBRANCHEZ LE COURANT AVANT TOUTE INSTALLATION.                                                                                                                                      |
| CAP ALL WIRING CONNECTIONS WITH UL APPROVED WIRE CONNECTORS.                                                                                                                         |
| COUVRIR TOUTES LES CABLES AVE DES CONNECTIONS APPROUVEES (UL).                                                                                                                       |
| VERIFY SUPPLY VOLTAGE MEETS LUMINAIRE LABEL SPECIFICATIONS.                                                                                                                          |
| VERIFIEZ QUE LA TENSION SOIT COMPATIBLE AVEC LES CARACTERISTIQUES DU LUMINAIRE MARQUE SUR LETIQUETTE.                                                                                |
| ALLOW FIXTURE TO COOL BEFORE TOUCHING HEATSINK OR LIGHT SOURCE.                                                                                                                      |
| LAISSEZ LE PROJECTEUR REFOIDIR AVANT DE TOUCHER LE RADIATEUR OU LA SOURCE DE LUMIERE.                                                                                                |
| DO NOT ATTEMPT TO OPEN OR MAKE REPAIRS INSIDE LUMINAIRE.                                                                                                                             |
| NE PAS TENTER DOUVRIRE OU DE FAIRE DES REPARATINS A L'INTERIEUR DU LUMINAIRE.                                                                                                        |
| AVOID DIRECT VIEWING OF LIGHT SOURCE.                                                                                                                                                |
| EVITEZ DE REGARDER DIRECTMENT LA SOURCE LUMINEUSE.                                                                                                                                   |
| THIS PRODUCT MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN.                                                                                                                           |
| CE PRODUIT DOIT ITRE INSTALLE PAR UN ELECTRICIEN QUALIFIE.                                                                                                                           |
| SUITABLE FOR UNDER-CABINET MOUNT.                                                                                                                                                    |
| ADAPTE POUR SOUS-CABINET MOUNT.                                                                                                                                                      |
| SUITABLE FOR DAMP LOCATION.                                                                                                                                                          |
| ADAOTE POUR DES ENDROITS HUMIDES.                                                                                                                                                    |
| SUITABLE FOR CONTINUOUS ROW MOUNTING.                                                                                                                                                |
| ADAPTE POUR CONTINU ROW MONTAGE.                                                                                                                                                     |



NOVA PRO D  
NOVA PRO D/I


Note: All pictures shown are  
NOVA D

# INSTALLATION INSTRUCTIONS

## Individual Pendant Mount (ACxxx)


1

Power must be turned off prior to disconnecting or reconnecting fixture. Slide pendant mount into place, and lock location by tightening set screw. Do not overtighten.

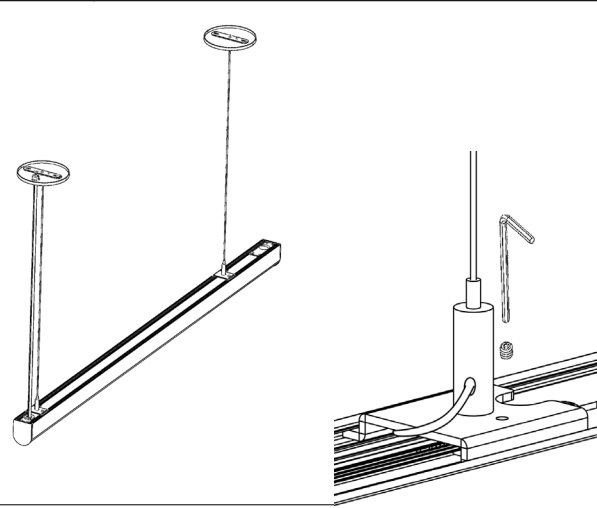

2

Locate ceiling mounting points according to supplied client drawing. Connect wire to building mains and then canopy to structure. Remove slack from cord attach strain relief to hole.

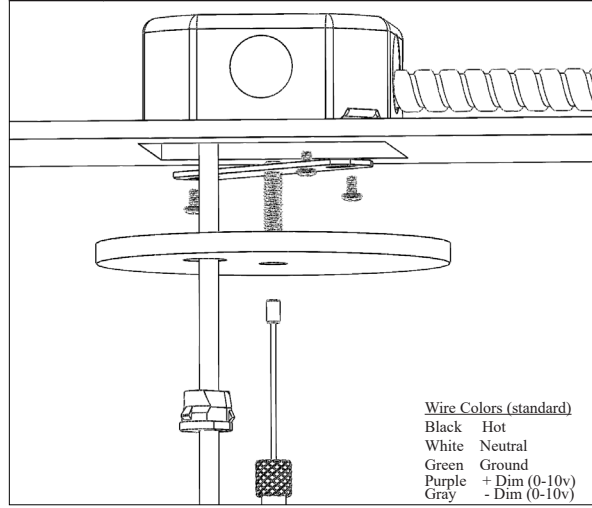


Wire Colors (standard)

|        |               |
|--------|---------------|
| Black  | Hot           |
| White  | Neutral       |
| Green  | Ground        |
| Purple | + Dim (0-10v) |
| Gray   | - Dim (0-10v) |


3

Power feed side. Secure canopy (A) with threaded coupler (B) on threaded stud (C)

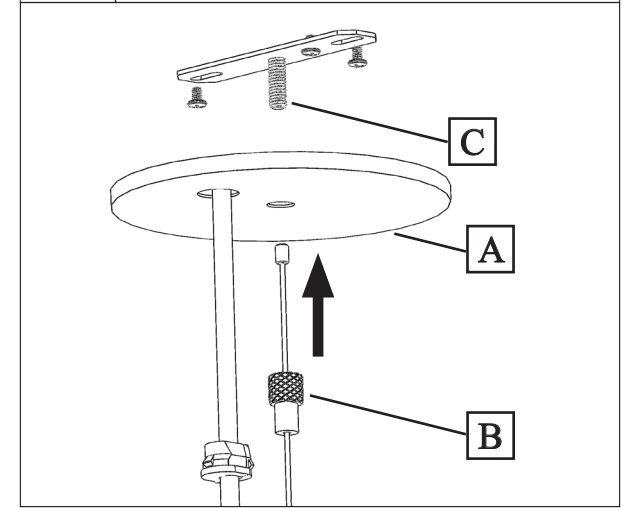


4

Non-power feed side. Secure canopy (D) with cable coupler (E) on threaded stud (F)

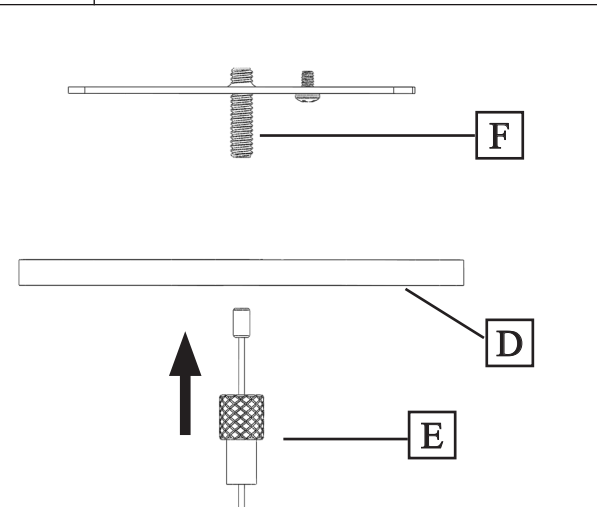


5

Level fixture by adjusting aircraft cable through grippers on both ends.

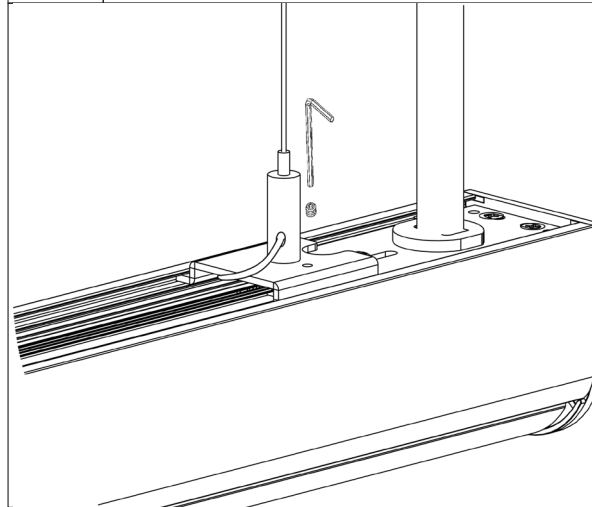







6

Restore power

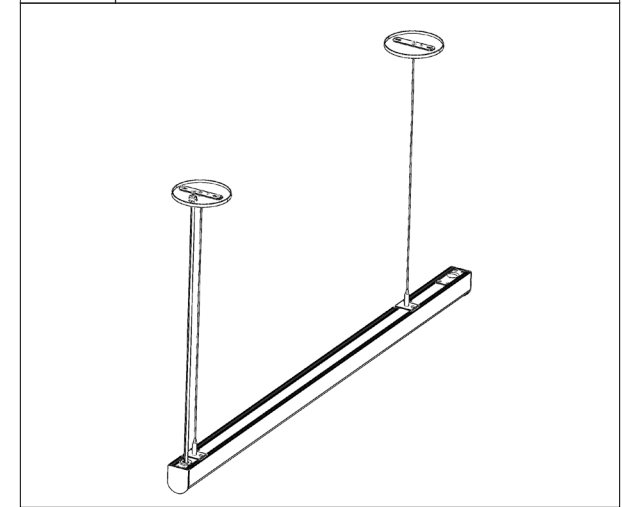







# INSTALLATION INSTRUCTIONS

## Continuous Pendant Mount (ACxxx)

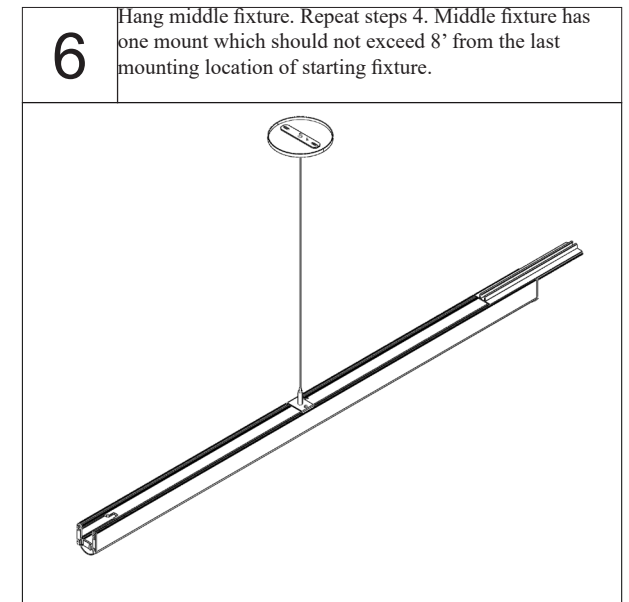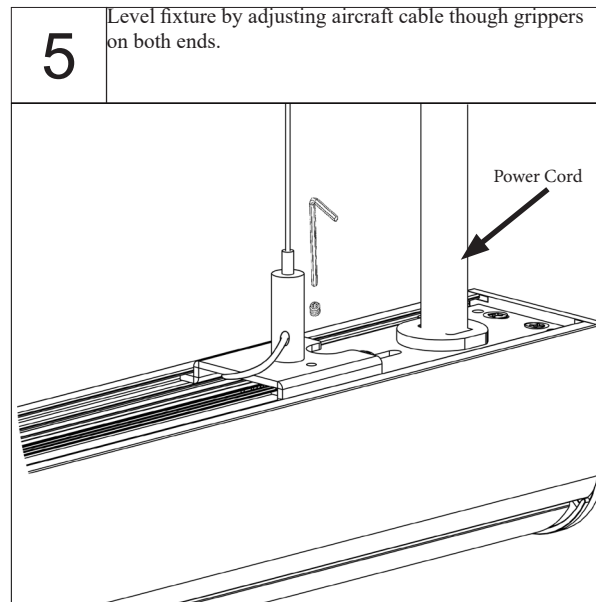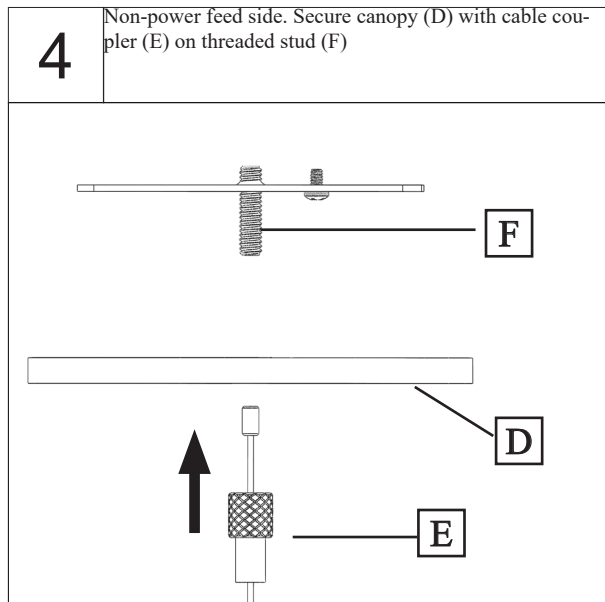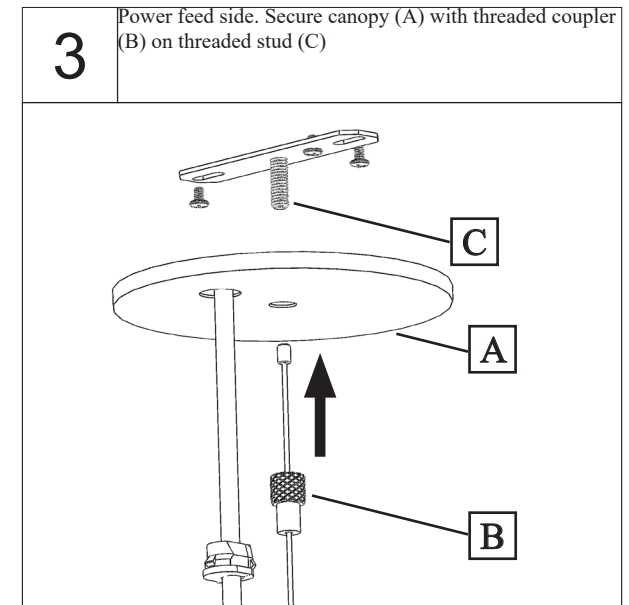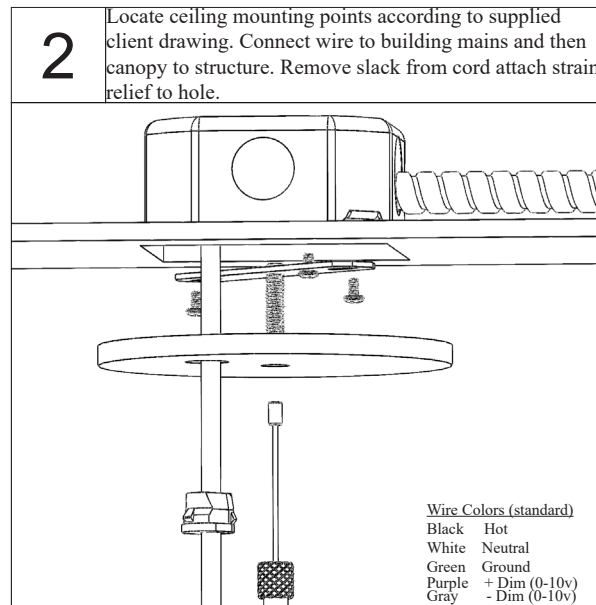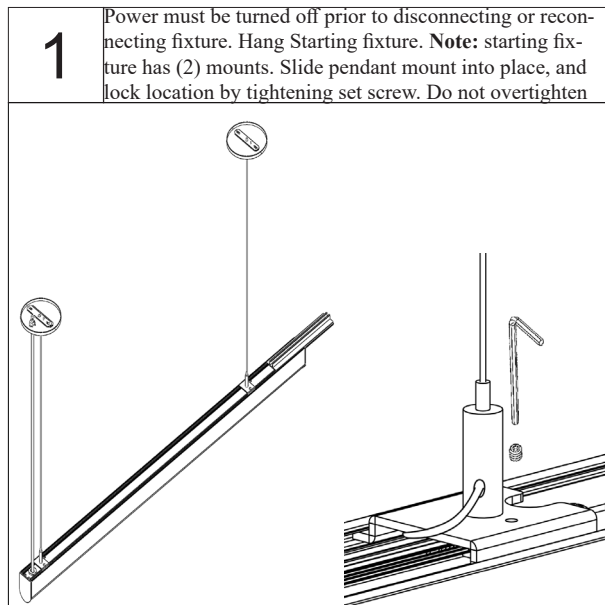

# INSTALLATION INSTRUCTIONS

## Continuous Pendant Mount (ACxxx)

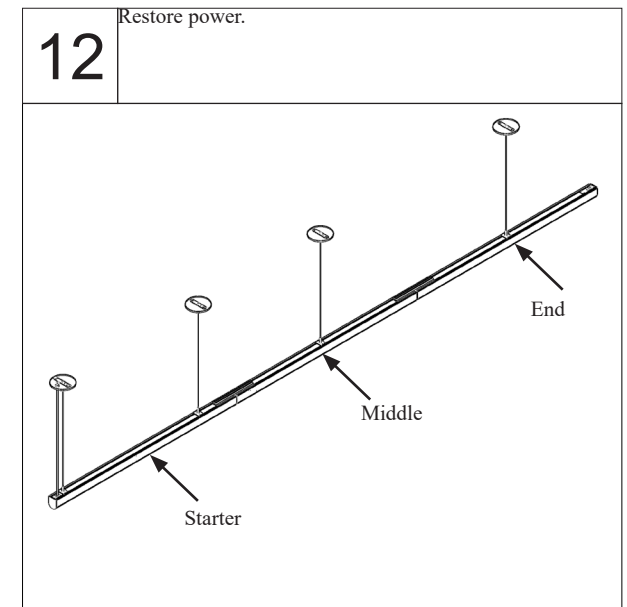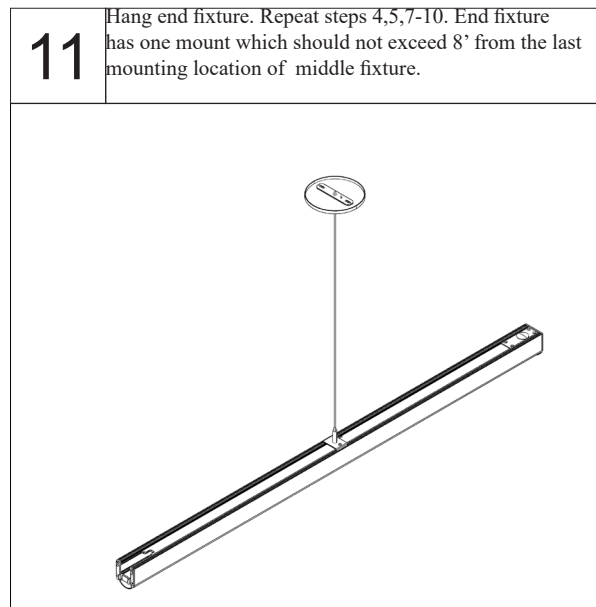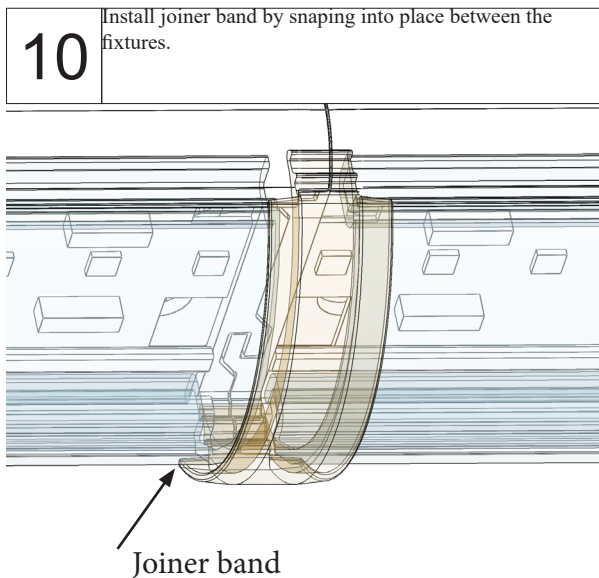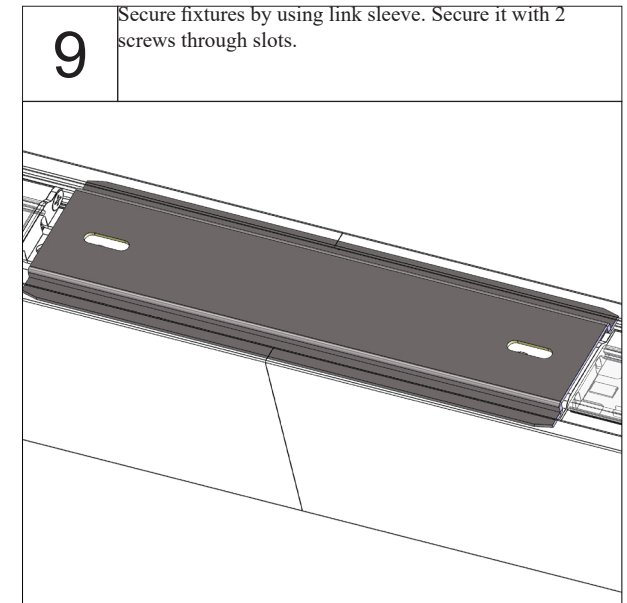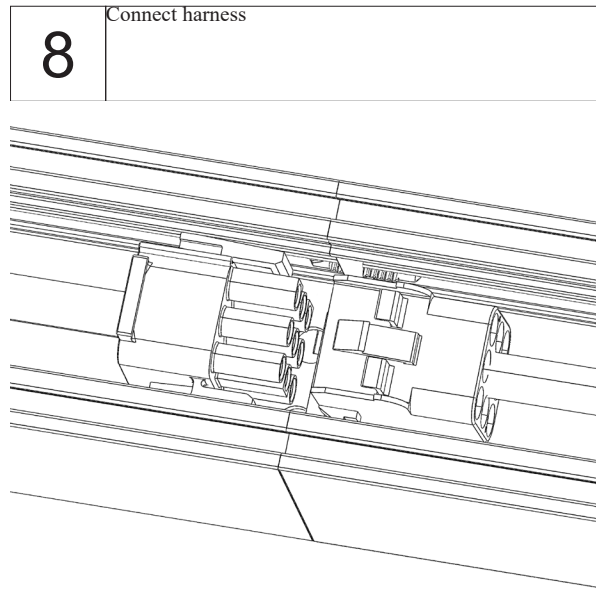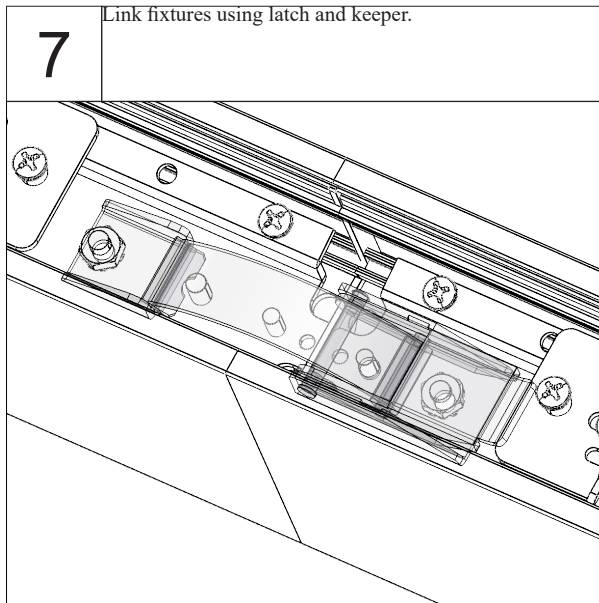


# INSTALLATION INSTRUCTIONS

## Individual Surface Mount (SM)


1

Power must be turned off prior to disconnecting or reconnecting fixture.

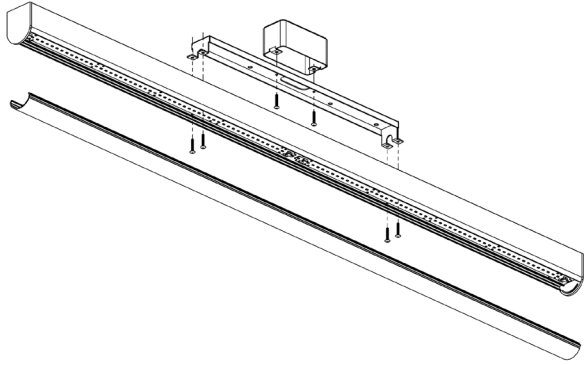


2

Install surface mounting bracket to structure/handy box (hardware by others) and pull wires through access hole.

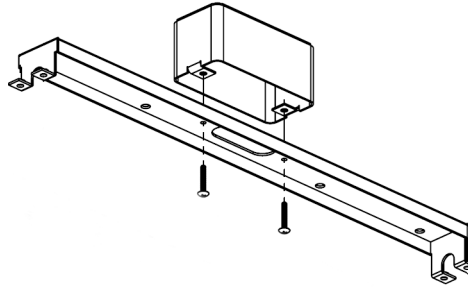

3


Connect fixture wires to building mains. Fasten fixture to surface mounting bracket with supplied hardware.

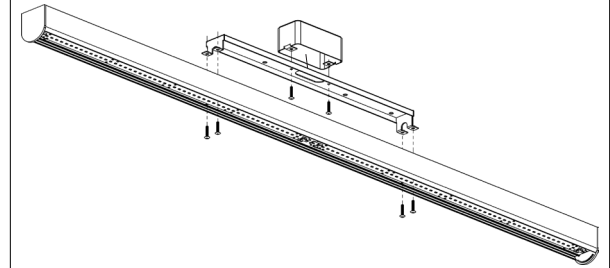

Wire Colors (standard)  
Black Hot  
White Neutral  
Green Ground  
Purple + Dim (0-10v)  
Gray - Dim (0-10v)

4

Snap diffuser in fixture and restore power.

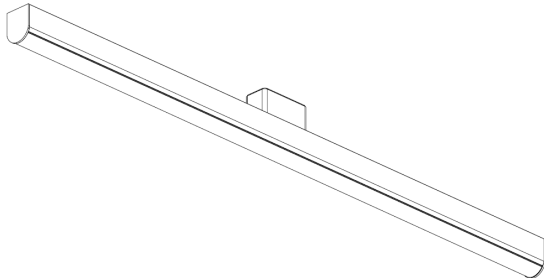


# INSTALLATION INSTRUCTIONS

## Continuous Surface Mount (SM)


1

Power must be turned off prior to disconnecting or reconnecting fixture.

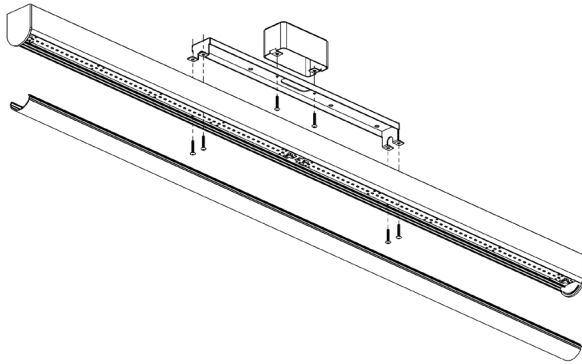


2

Install surface mounting bracket to structure/handy box (hardware by others) and pull wires through access hole.

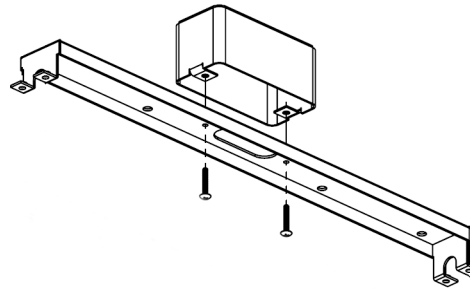

3


Connect fixture wires to building mains. Fasten fixture to surface mounting bracket with supplied hardware.

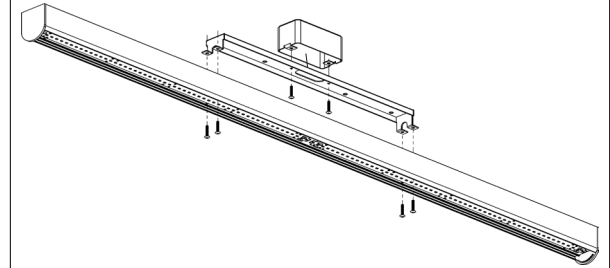

Wire Colors (standard)  
Black Hot  
White Neutral  
Green Ground  
Purple + Dim (0-10v)  
Gray - Dim (0-10v)


4

Measure end to end of middle fixture and install center of surface mounting bracket at half the measured length away from the end of the starter fixture. Repeat Step 2 to secure surface mounting bracket to structure.

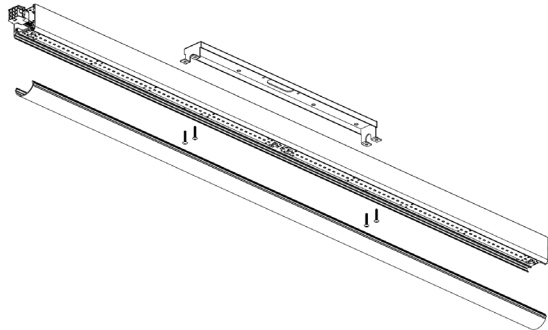


5

Connect harness

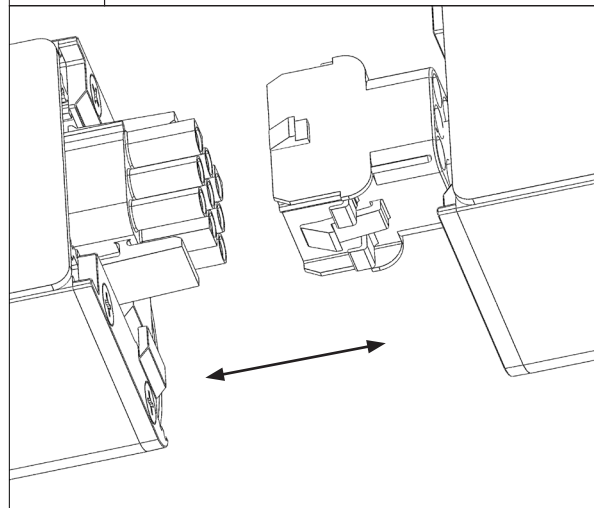



6

Connect fixtures with interlocking endcaps.

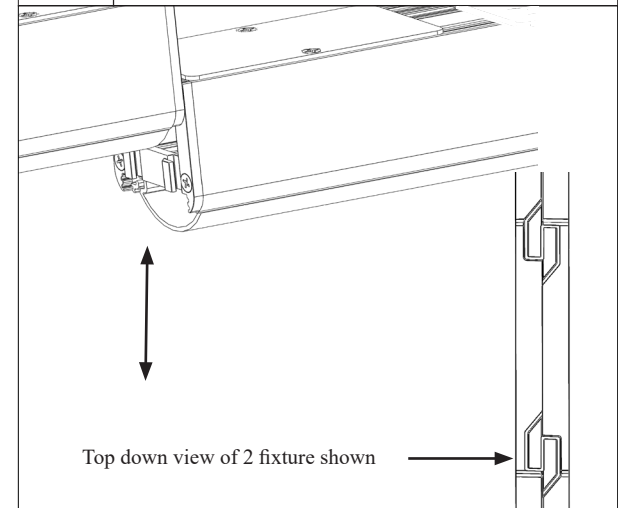






# INSTALLATION INSTRUCTIONS

## Continuous Surface Mount (SM)

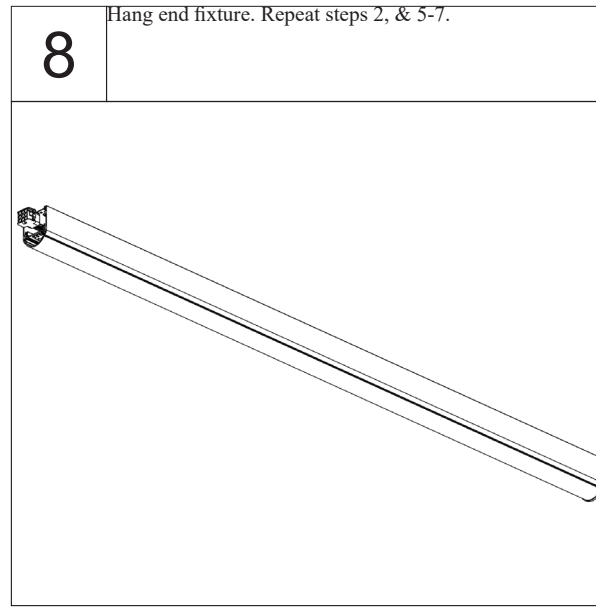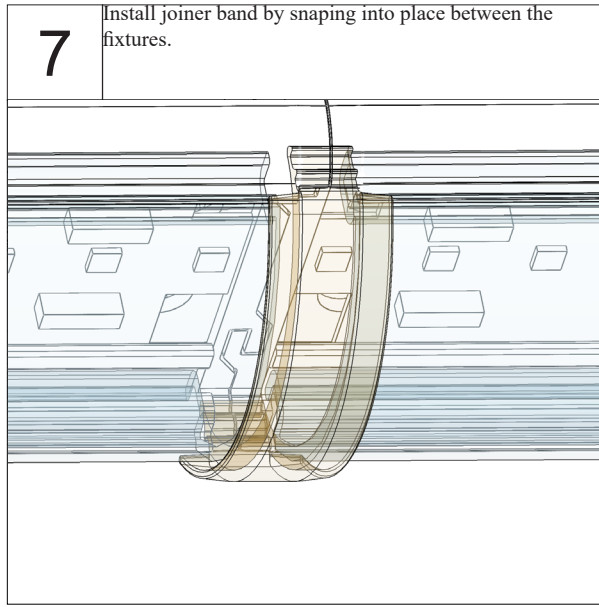







# INSTALLATION INSTRUCTIONS

## Individual T-Grid Mount (TM)

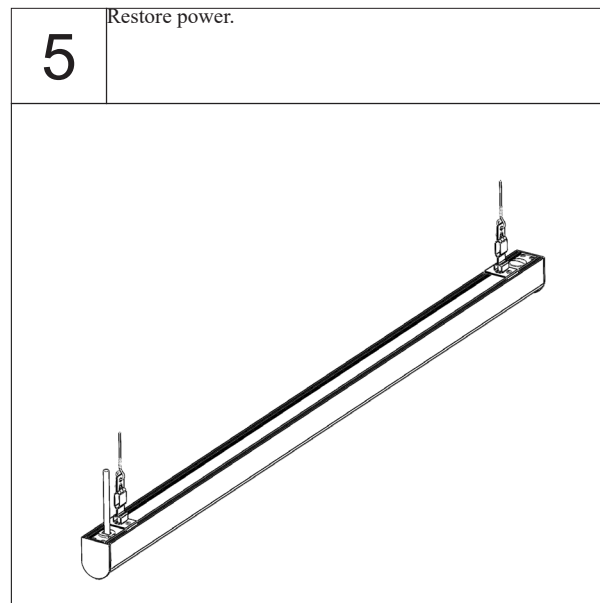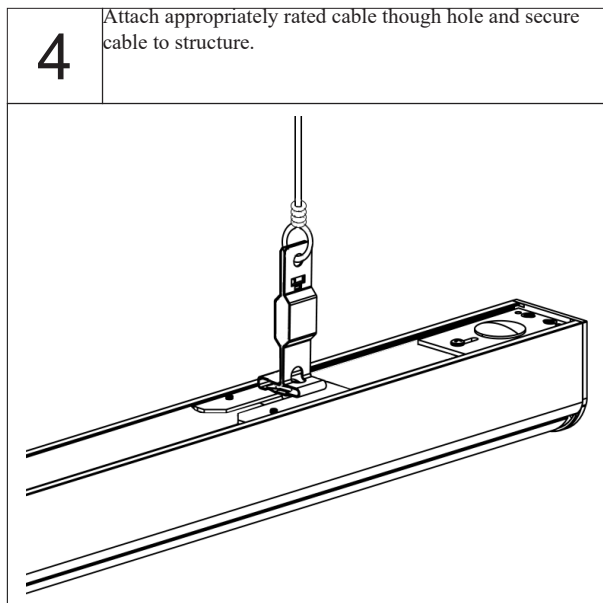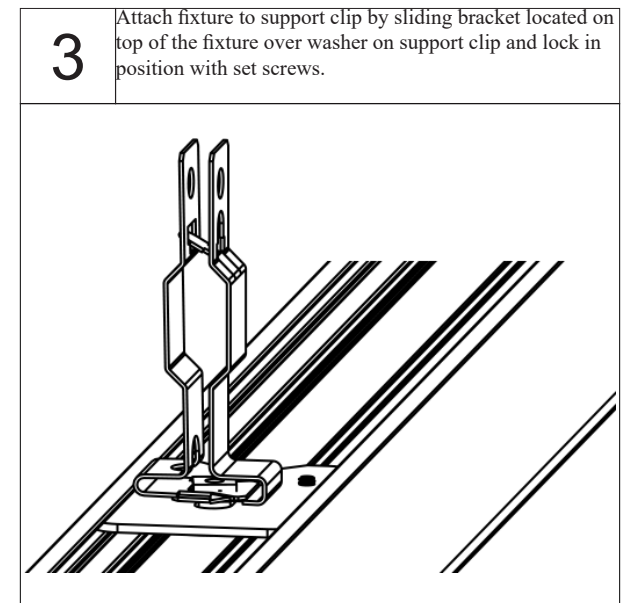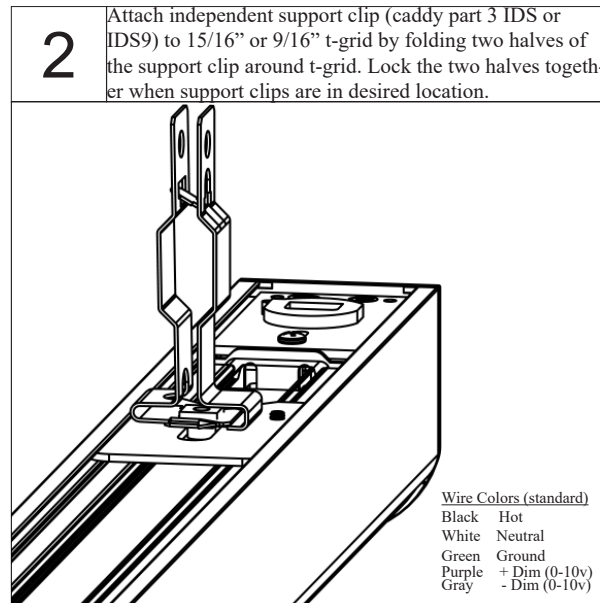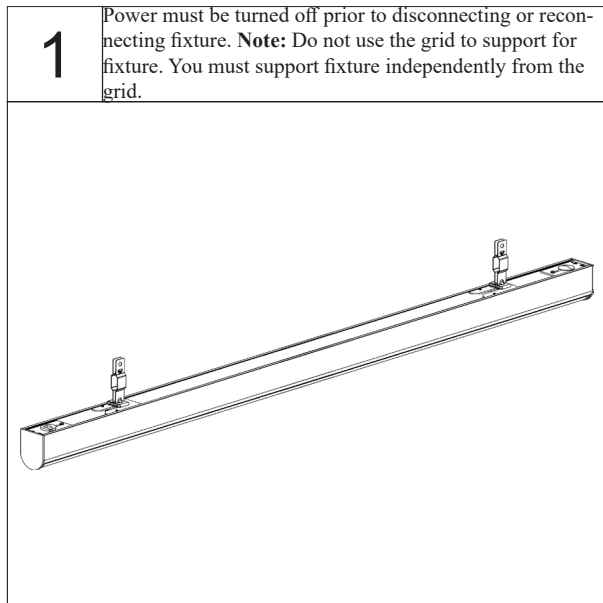

# INSTALLATION INSTRUCTIONS

## Continuous T-Grid Mount (TM)

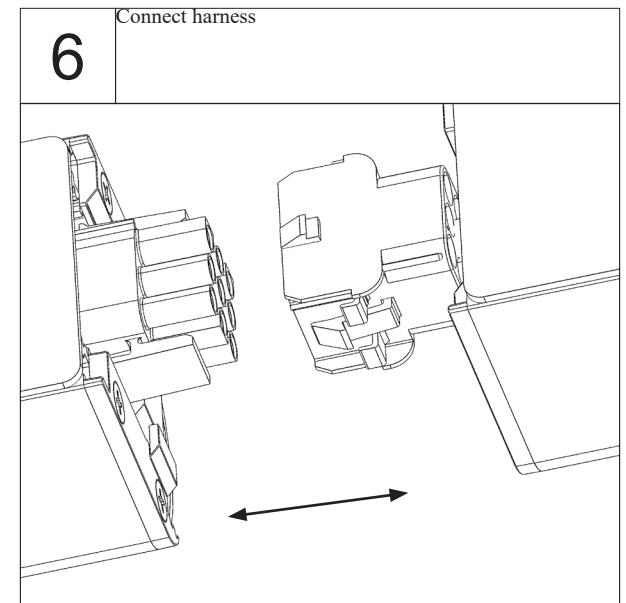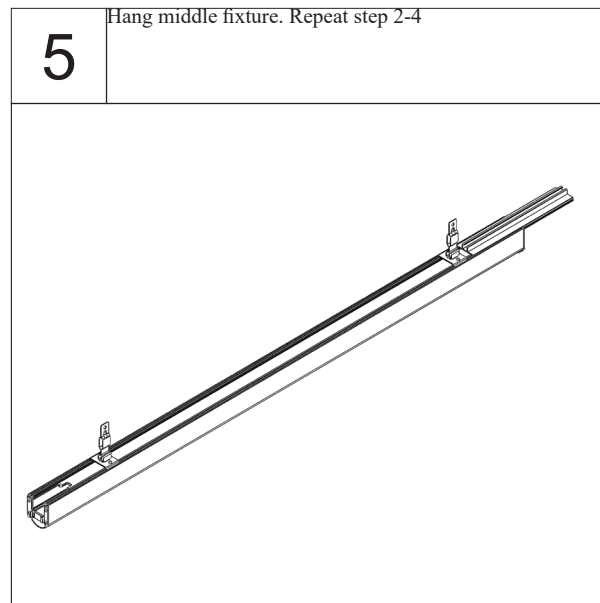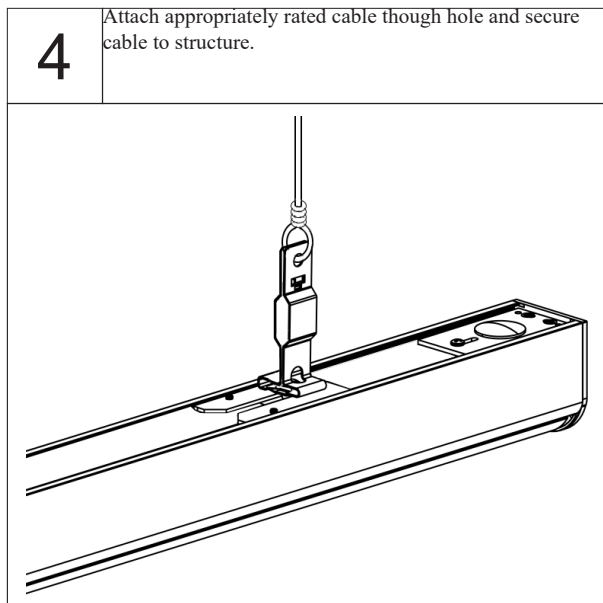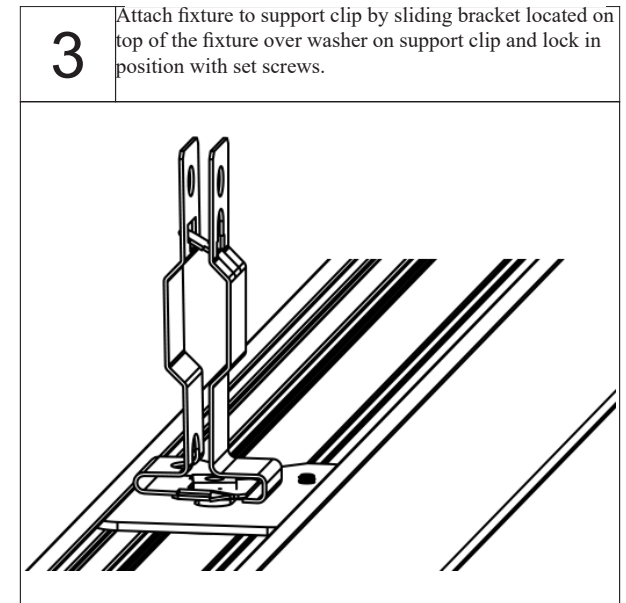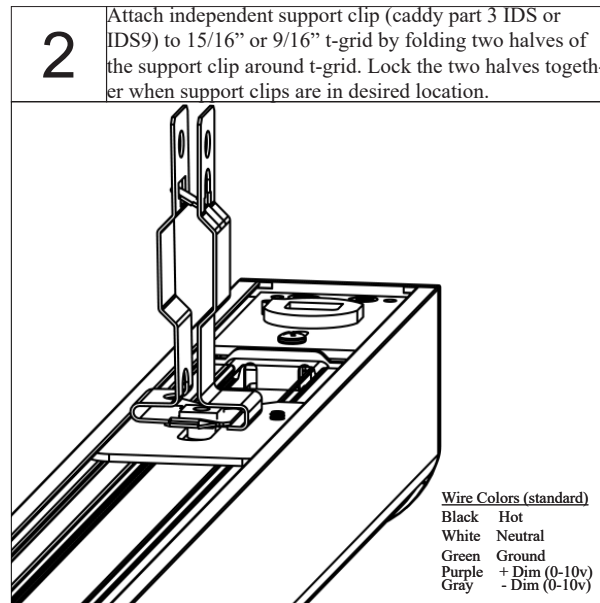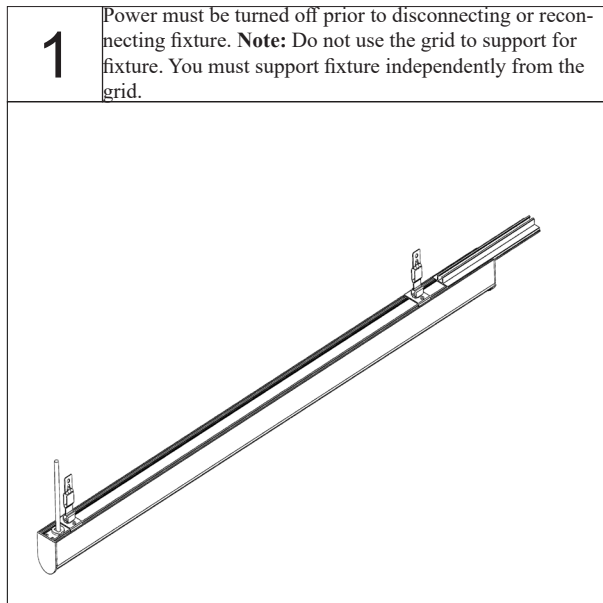

# INSTALLATION INSTRUCTIONS

## Continuous T-Grid Mount (TM)

